

# UPSMON PRO V1.43

UPS Monitoring Software

User's Manual

## Contents

<a href="#"><u>AA. UPSMON PRO Install</u></a>	<a href="#"><u>3</u></a>
<a href="#"><u>BB. UPSMON PRO Start</u></a>	<a href="#"><u>4</u></a>
<a href="#"><u>CC. UPSMON PRO Status</u></a>	<a href="#"><u>7</u></a>
<a href="#"><u>DD. UPSMON PRO Config</u></a>	<a href="#"><u>10</u></a>
<a href="#"><u>EE. UPSMON PRO Set</u></a>	<a href="#"><u>11</u></a>
<a href="#"><u>FF. UPSMON PRO Multi-Connect</u></a>	<a href="#"><u>13</u></a>
<a href="#"><u>GG. UPSMON PRO Auto Start</u></a>	<a href="#"><u>15</u></a>
<a href="#"><u>HH. VMWare Support</u></a>	<a href="#"><u>16</u></a>
<a href="#"><u>II. Q and A</u></a>	<a href="#"><u>20</u></a>

## AA. UPSMON PRO Install


A.1. Command : `cp UPSMON_PRO_Linux.tar /home/user`

A.2. Command : `tar -xvf UPSMON_PRO_Linux.tar`

A.3. Command : `cd UPSMON_PRO_Linux`

==> These command will copy and uncompressed this ups monitoring software

==> And the package contains executable files about ups monitoring, configuration, and control

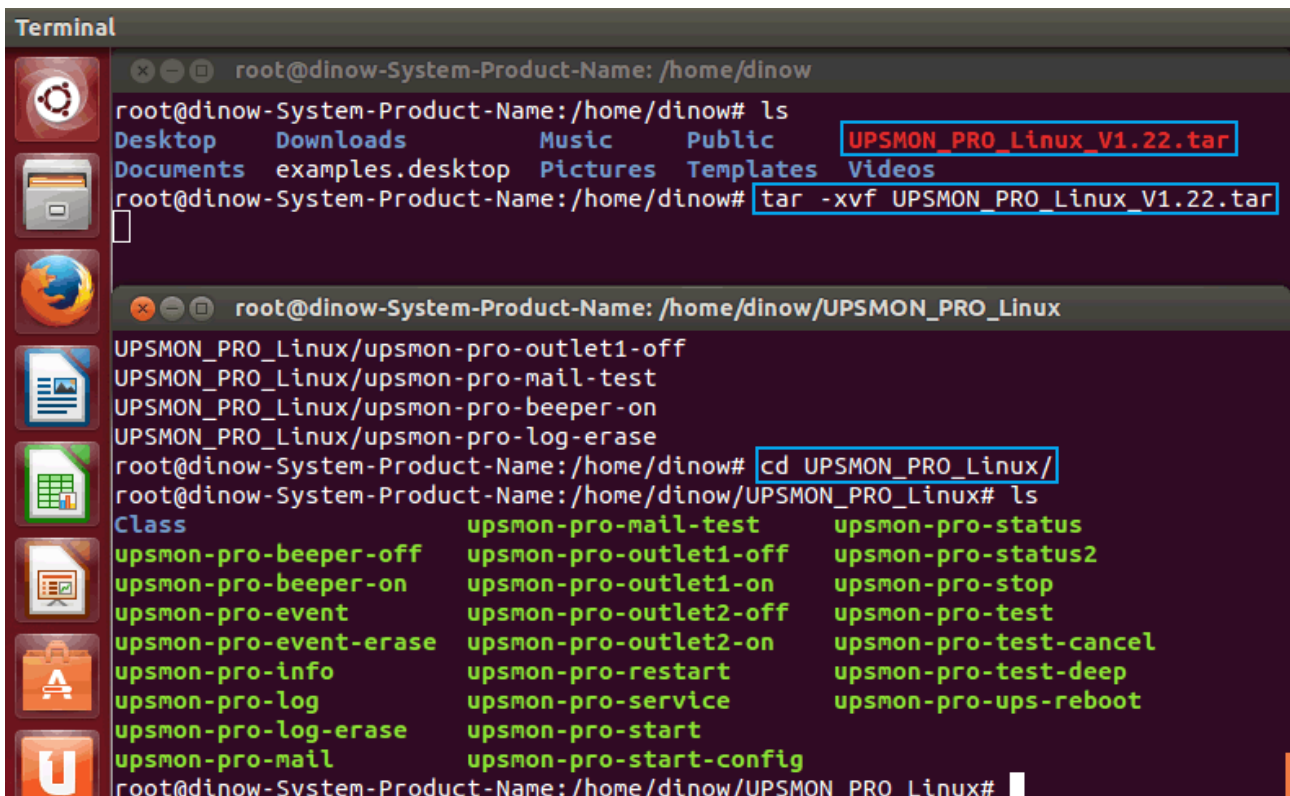

```

Terminal
root@dinow-System-Product-Name: /home/dinow
root@dinow-System-Product-Name:/home/dinow# ls
Desktop  Downloads  Music  Public  UPSMON_PRO_Linux_V1.22.tar
Documents examples.desktop Pictures Templates Videos
root@dinow-System-Product-Name:/home/dinow# tar -xvf UPSMON_PRO_Linux_V1.22.tar
root@dinow-System-Product-Name:/home/dinow/UPSMON_PRO_Linux#
UPSMON_PRO_Linux/upsmon-pro-outlet1-off
UPSMON_PRO_Linux/upsmon-pro-mail-test
UPSMON_PRO_Linux/upsmon-pro-beeper-on
UPSMON_PRO_Linux/upsmon-pro-log-erase
root@dinow-System-Product-Name:/home/dinow# cd UPSMON_PRO_Linux/
root@dinow-System-Product-Name:/home/dinow/UPSMON_PRO_Linux# ls
Class                                upsmon-pro-mail-test               upsmon-pro-status
upsmon-pro-beeper-off               upsmon-pro-outlet1-off             upsmon-pro-status2
upsmon-pro-beeper-on               upsmon-pro-outlet1-on              upsmon-pro-stop
upsmon-pro-event                   upsmon-pro-outlet2-off             upsmon-pro-test
upsmon-pro-event-erase              upsmon-pro-outlet2-on              upsmon-pro-test-cancel
upsmon-pro-info                    upsmon-pro-restart                 upsmon-pro-test-deep
upsmon-pro-log                    upsmon-pro-service                 upsmon-pro-ups-reboot
upsmon-pro-log-erase               upsmon-pro-start
upsmon-pro-mail                    upsmon-pro-start-config
root@dinow-System-Product-Name:/home/dinow/UPSMON PRO Linux#

```

Diagram : UPSMON PRO Install (Ubuntu)

## BB. UPSMON PRO Start

### B.1. Command : **upsmon-pro-start**

==> It will ask you the basic information and then auto start ups monitoring service


- **a. UPS Connection** : 1.RS232 2.USB 3.SNMP-Card 4.UPSMON-PRO
- **b. Linux shutdown delay seconds** : When power failure occurs, Linux will act shutdown after this count down seconds
- **c. Linux shutdown if battery capacity** : Linux act shutdown at once if battery descend to this level
- **d. Linux shutdown if battery backup minutes** : Linux act shutdown at once if battery estimated backup time descend to this minutes
- **e. Ups shutdown delay minutes** : Once Linux commit shutdown, ups will sustain power for these minutes

==> **UPSMON : UPSMON Start**

==> It means the program successfully execute

==> **UPSMON : Start Monitor**

==> It means the program successfully get ups connection

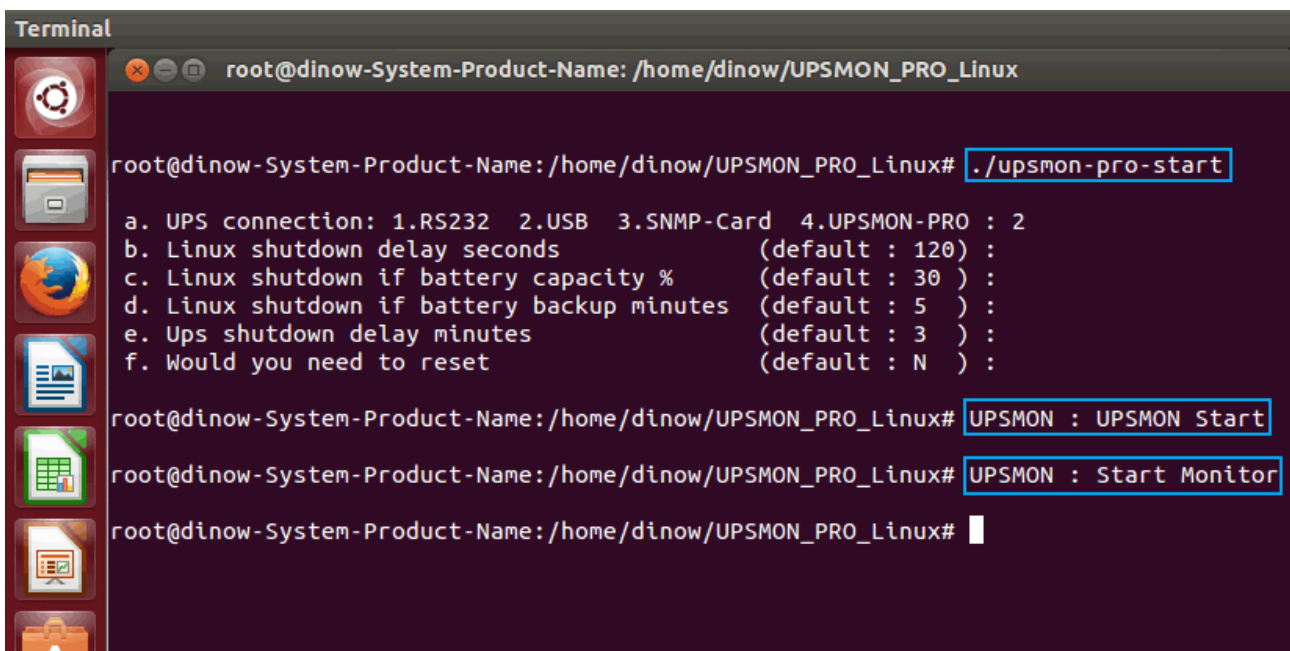

```

Terminal
root@dinow-System-Product-Name: /home/dinow/UPSMON_PRO_Linux

root@dinow-System-Product-Name:/home/dinow/UPSMON_PRO_Linux# ./upsmon-pro-start

a. UPS connection: 1.RS232 2.USB 3.SNMP-Card 4.UPSMON-PRO : 2
b. Linux shutdown delay seconds (default : 120) :
c. Linux shutdown if battery capacity % (default : 30 ) :
d. Linux shutdown if battery backup minutes (default : 5 ) :
e. Ups shutdown delay minutes (default : 3 ) :
f. Would you need to reset (default : N ) :

root@dinow-System-Product-Name:/home/dinow/UPSMON_PRO_Linux# UPSMON : UPSMON Start

root@dinow-System-Product-Name:/home/dinow/UPSMON_PRO_Linux# UPSMON : Start Monitor

root@dinow-System-Product-Name:/home/dinow/UPSMON_PRO_Linux#
  
```

Diagram : USB Connection

```

dinow@linux-s9bl:~/Desktop
File Edit View Terminal Tabs Help

linux-s9bl:/home/dinow/UPSMON_PRO_Linux # ./upsmon-pro-start

a. UPS connection: 1.RS232  2.USB  3.SNMP-Card  4.UPSMON-PRO : 1
b. Name and path of serial port                      (ex:/dev/ttyS0) : /dev/ttyS0
c. Linux shutdown delay seconds                      (default : 120) : 90
d. Linux shutdown if battery capacity %              (default : 30 ) :
e. Linux shutdown if battery backup minutes          (default : 5  ) :
f. Ups shutdown delay minutes                        (default : 3  ) : 2
g. Would you need to reset                           (default : N  ) :

linux-s9bl:/home/dinow/UPSMON_PRO_Linux # UPSMON : UPSMON Start

linux-s9bl:/home/dinow/UPSMON_PRO_Linux # UPSMON : Start Monitor

```

Diagram : RS232 Connection (SuSe)

```

Applications Places System
dinow@localhost:/home/dinow/UPSMON_PRO_Linux
File Edit View Search Terminal Help

[root@localhost UPSMON_PRO_Linux]# ./upsmon-pro-start

a. UPS connection: 1.RS232  2.USB  3.SNMP-Card  4.UPSMON-PRO : 3
b. SNMP-Card IP address                                     : 10.192.136.236
c. Linux shutdown delay seconds                      (default : 120) : 180
d. Linux shutdown if battery capacity %              (default : 30 ) :
e. Linux shutdown if battery backup minutes          (default : 5  ) :
f. Ups shutdown delay minutes                        (default : 3  ) : 5
g. Would you need to reset                           (default : N  ) :

[root@localhost UPSMON_PRO_Linux]# UPSMON : UPSMON Start

[root@localhost UPSMON_PRO_Linux]# UPSMON : Start Monitor

[root@localhost UPSMON_PRO_Linux]# █

```

Diagram : SNMPCard Connection (CentOS)

B.2 After you get the description “UPSMON:Start Monitor”, please command immediately with “**upsmon-pro-status**” to make sure the connection and ups condition is all right.

### B.3 Command : **upsmon-pro-stop**

==> It will stop ups monitoring service

### B.4 Command : **upsmon-pro-service**

==> This command directly start ups monitoring without any information query

[\(Add this within start daemon\)](#)


### B.5 Command : **upsmon-pro-restart**

==> This command will restart the ups monitoring

### B.6. Command : **upsmon-pro-start-config**

==> This command will reset ups connection and shutdown condition

==> Ups outlet off delay seconds : This function depends on specific ups model

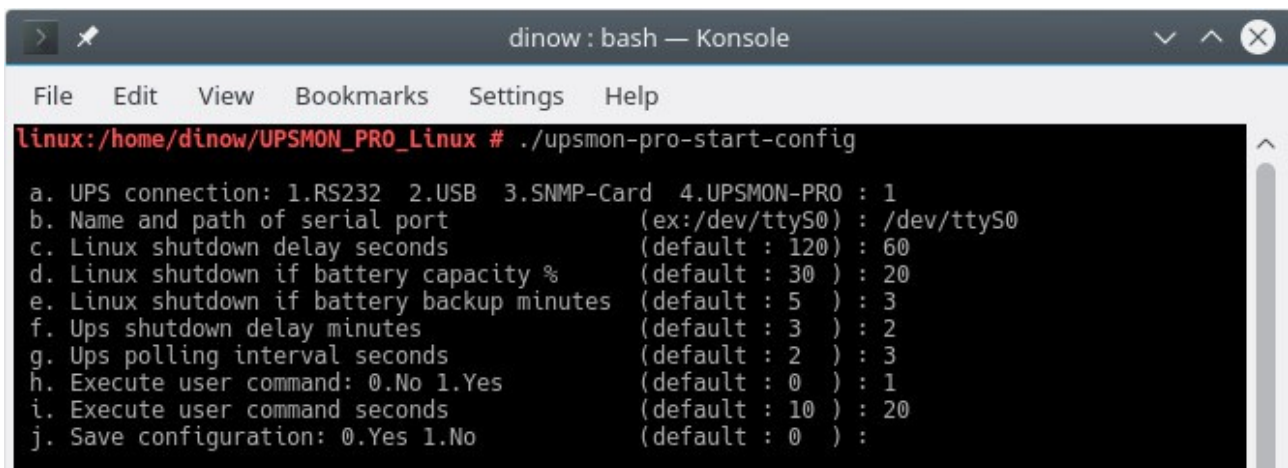

```
dinow : bash — Konsole
File Edit View Bookmarks Settings Help
linux:/home/dinow/UPSMON_PRO_Linux # ./upsmon-pro-start-config
a. UPS connection: 1.RS232 2.USB 3.SNMP-Card 4.UPSMON-PRO : 1
b. Name and path of serial port (ex:/dev/ttyS0) : /dev/ttyS0
c. Linux shutdown delay seconds (default : 120) : 60
d. Linux shutdown if battery capacity % (default : 30 ) : 20
e. Linux shutdown if battery backup minutes (default : 5 ) : 3
f. Ups shutdown delay minutes (default : 3 ) : 2
g. Ups polling interval seconds (default : 2 ) : 3
h. Execute user command: 0.No 1.Yes (default : 0 ) : 1
i. Execute user command seconds (default : 10 ) : 20
j. Save configuration: 0.Yes 1.No (default : 0 ) :
```

Diagram : Start Config

## CC. UPSMON PRO Status

### C.1 Command : **upsmon-pro-status**

==> It will repeatedly poll you current ups status until Ctrl-C pressing

- **Power Status** : Battery Power / Utility Power
- **Input Voltage** : To display utility power voltage
- **Input Frequency** : To display utility power frequency
- **Output Voltage** : To display ups output voltage
- **Output Power** : To display ups output power
- **UPS Status** : Normal / Bypass / AVR Boost / AVR Buck / UPS Failed
- **UPS Load** : To display total capacity of loads
- **UPS Temperature** : To display ups inside temperature
- **UPS Beeper** : ON / OFF
- **Battery Status**: Normal/ Charge/ Discharge / Battery Test / Low Battery / Battery Failed
- **Battery Capacity** : To display battery percentage level
- **Battery Voltage** : To display battery its voltage
- **Battery Backup Time** : To display battery estimated backup time in battery mode
- **Battery Test Times** : Accumulated times that ups made battery test
- **Battery Last Test** : The last time this ups made battery test
- **Battery Test Result** : Normal / Battery Failed / Low Battery
- **Battery Power Times** : Accumulated times that ups output power supply from batteries
- **Battery Power Start** : The last time ups switch power from its battery
- **Battery Power End** : The last time ups switch power to utility
- **Battery Age** : The age of ups batteries have used
- **Ambient Temperature** : The sense of environmental temperature
- **Ambient Humidity** : The sense of environmental humidity
- **Upsmon Pro Linux** : This ups monitoring software version
- **Upsmon Pro Status** : Monitoring / Disconnect
- **Upsmon Pro Data Update** : The data update time
- **Upsmon Pro is going to shutdown after XXX seconds** : Blackout and shutdown mode

```

root@dinow-System-Product-Name: /home/dinow/UPSMON_PRO_Linux
Power Status      : AC Utility Power
Input Voltage     : 110 Volts
Input Frequency   : 60 Hz
Output Voltage    : 120 Volts
Output Power      : 34 Watt
Ups Status        : Normal
Ups Load          : 3 Percent
Ups Temperature   : 32 C
Ups Beeper        : OFF
Battery Status    : Normal
Battery Capacity  : 100 Percent
Battery Voltage   : 22.0 Volts
Battery Test Times : 3 Times
Battery Last Test : 11:43:51 2015/06/01
Battery Test Result : Battery Normal
Battery Power Times : 3 Times
Battery Power Start : 11:46:16 2015/06/01
Battery Power End   : 11:46:44 2015/06/01
Battery Age        : 1 Month
Ambient Temperature : 28 C
Ambient Humidity   : 45 Percent
Upsmon Pro Linux   : V1.22
Upsmon Pro Status  : Monitoring
Upsmon Pro Update  : 13:32:37 2015/06/01
  
```


Diagram : UPS Status

## C.2 Command : **upsmon-pro-info**

==> To display ups service / devices information / and configuration.

- **Ups Company** : The manufacture of the ups
- **Ups Model** : The ups model name
- **Ups Firmware** : The ups firmware version
- **Rating Input Volt** : Rating Input Voltage
- **Rating Output Volt** : Rating Output Voltage
- **Upsmon Pro Connect** : RS232 / USB / SNMP-Card / UPSMON-PRO
- **Upsmon Pro RS232 Port Name and Path** : Serial port path (ex : /dev/ttyS0)
- **Upsmon Pro Master IP** : The IP address of Upsmon Pro Master (RS232 or USB)
- **Snmpp Card IP** : The IP address of snmp card
- **Snmpp Card firmware** : The firmware version of snmp card
- **Snmpp Card Community** : The community of snmp card
- **Upsmon Pro Usb VID & PID** : Usb vendor ID and Usb product ID
- **Upsmon Pro Usb Type** : Driver for usb/hid ups equipment
- **Polling Interval** : The query interval to ups
- **Linux shutdown delay seconds** : When power failure occurs, Linux will act shutdown after this count down seconds
- **Linux shutdown if battery capacity** : Linux act shutdown at once if battery descend to this level

- **Linux shutdown if battery backup minutes** : Linux act shutdown at once if ups estimated battery backup time descend to this minutes
- **Ups shutdown delay minutes** : Once Linux commit shutdown, ups will sustain power for these minutes

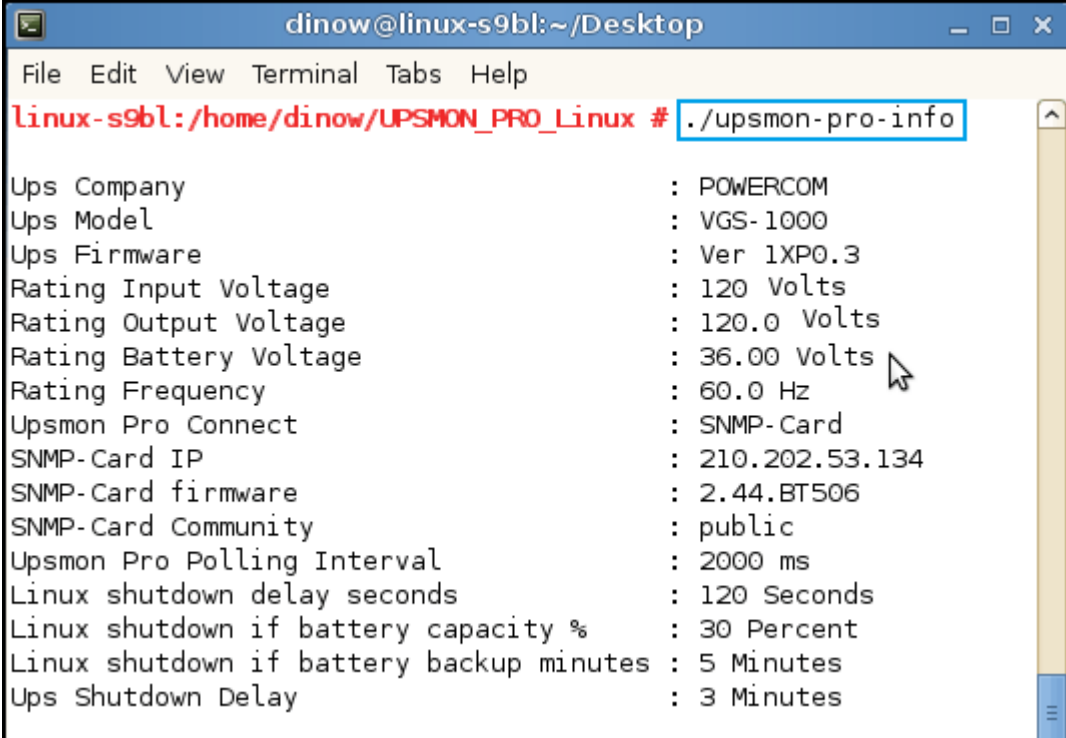

```

dinow@linux-s9bl:~/Desktop
File Edit View Terminal Tabs Help
linux-s9bl:/home/dinow/UPSMON_PRO_Linux # ./upsmon-pro-info

Ups Company                : POWERCOM
Ups Model                  : VGS-1000
Ups Firmware               : Ver 1XP0.3
Rating Input Voltage       : 120 Volts
Rating Output Voltage      : 120.0 Volts
Rating Battery Voltage     : 36.00 Volts
Rating Frequency           : 60.0 Hz
Upsmon Pro Connect         : SNMP-Card
SNMP-Card IP              : 210.202.53.134
SNMP-Card firmware        : 2.44.BT506
SNMP-Card Community       : public
Upsmon Pro Polling Interval : 2000 ms
Linux shutdown delay seconds : 120 Seconds
Linux shutdown if battery capacity % : 30 Percent
Linux shutdown if battery backup minutes : 5 Minutes
Ups Shutdown Delay        : 3 Minutes
  
```

Diagram : UPS Information

### C.3 Command : **upsmon-pro-log**

==> To list the ups data log

### C.4 Command : **upsmon-pro-log-erase**

==> To erase the ups data log

==> To avoid data conflict, please execute this command without upsmon pro service running

### C.5 Command : **upsmon-pro-event**

==> To list the ups event

### C.6 Command : **upsmon-pro-log-erase**

==> To erase the ups event

==> To avoid data conflict, please execute this command without upsmon pro service running

## DD. UPSMON PRO Config

### D.1 Command : **upsmon-pro-mail**

==> This configuration will help you to get email notification once ups events occurs

- **a. E-Mail Server Enable** : Y / n
- **b. E-Mail Server Name or IP** : Email server address
- **c. E-Mail Server Port** : 25 (default)
- **d. E-Mail Account** : The account of this email server
- **e. E-Mail Password** : The password of this email account
- **f. SSL Requires** : This mail server requires an secure connection
- **g. E-Mail Sender** : The email address of this account
- **h. E-Mail Recipient** : The recipient who needs to get email notification

### D.2 Command : **upsmon-pro-mail-test**


==> This command will send a test mail to make sure your configuration is success or not

```
dinow@linux-s9bl:~/Desktop
File Edit View Terminal Tabs Help
linux-s9bl:/home/dinow/UPSMON_PRO_Linux # ./upsmon-pro-mail

a. E-Mail Server Enable (Y/n):
b. E-Mail Server Name or IP : smtp.gmail.com
c. E-Mail Server Port (default : 25): 587
d. E-Mail Account : dinow46
e. E-Mail Password :
f. SSL Requires (Y/n):
g. E-Mail Sender : dinow46@gmail.com
h. E-Mail Recipient : dinow@upspowercom.com.tw
i. Would you need to reset (N/y):

linux-s9bl:/home/dinow/UPSMON_PRO_Linux #
linux-s9bl:/home/dinow/UPSMON_PRO_Linux # ./upsmon-pro-mail-test
linux-s9bl:/home/dinow/UPSMON_PRO_Linux #
linux-s9bl:/home/dinow/UPSMON_PRO_Linux # UPSMON : Email Test

linux-s9bl:/home/dinow/UPSMON_PRO_Linux #
```

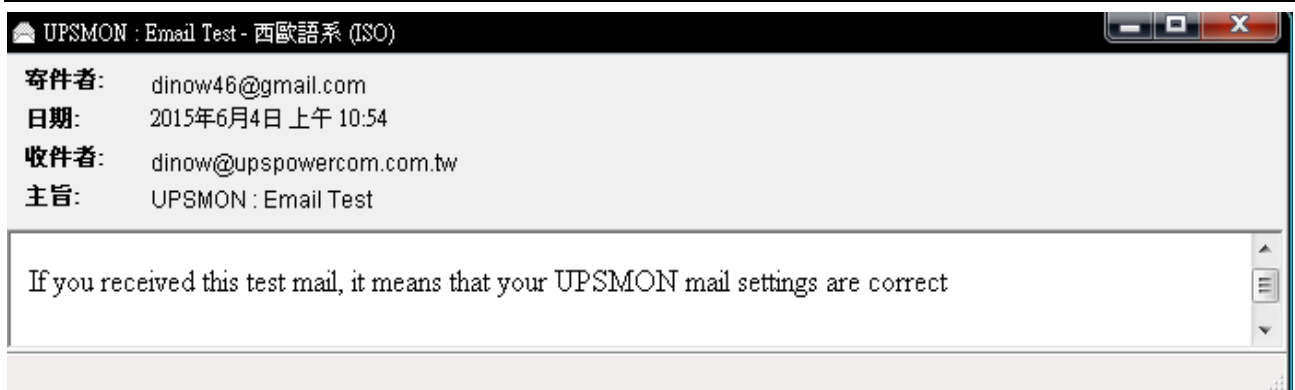

## EE. UPSMON PRO Set

### E.1 Command : **upsmon-pro-test**


==> To check the battery health, ups will supply the power shortly from its battery

### E.2 Command : **upsmon-pro-test-deep**

==> To simulate battery capability, ups will supply battery power for its limits

### E.3 Command : **upsmon-pro-test-cancel**

==> With this command, it will cease deep battery power test

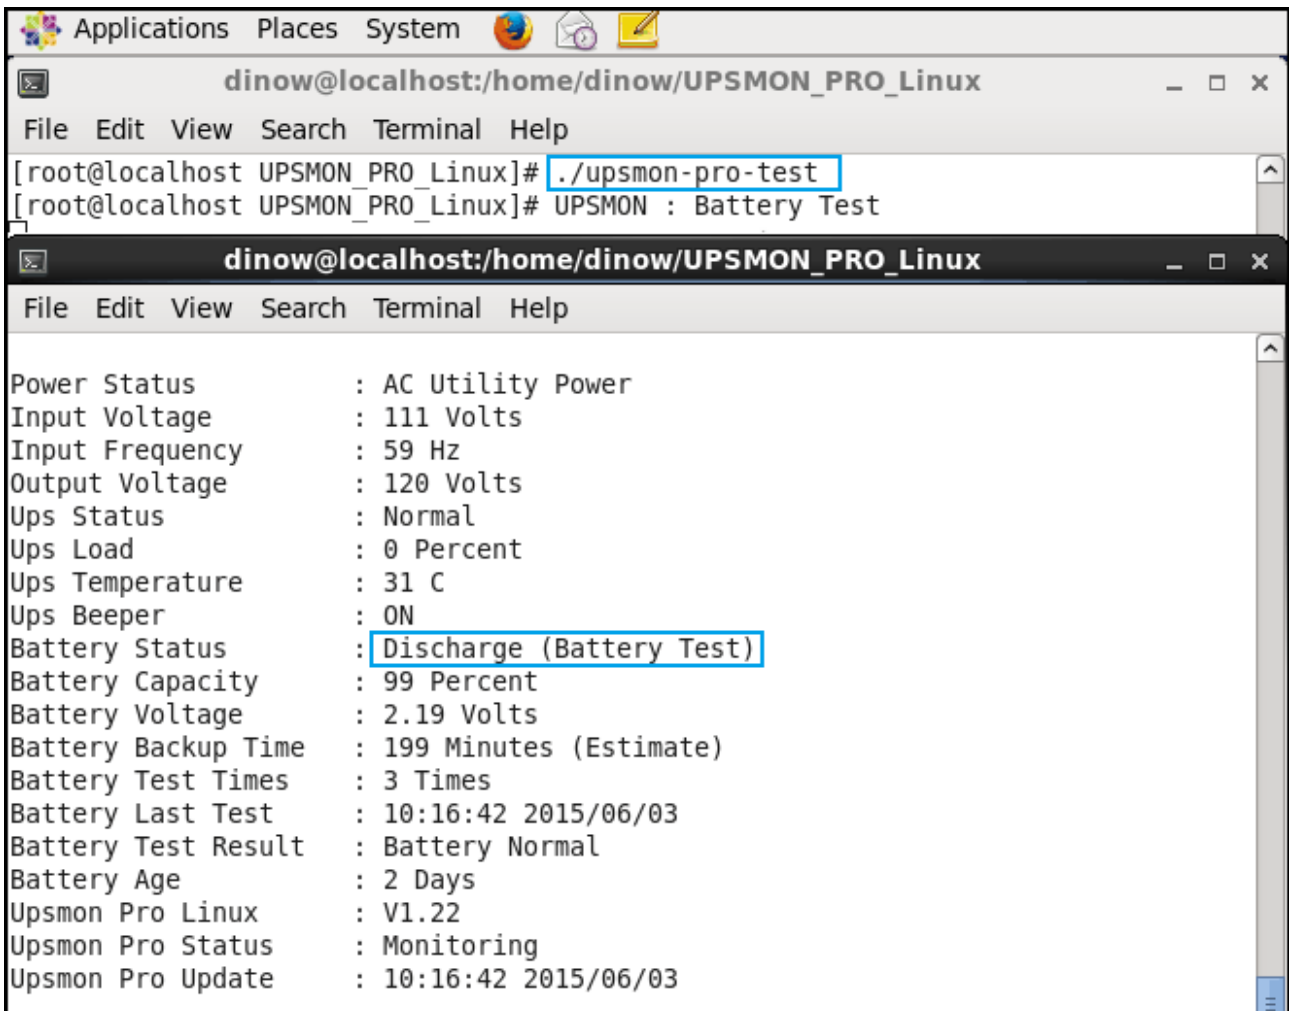

```

dinow@localhost:/home/dinow/UPSMON_PRO_Linux
File Edit View Search Terminal Help
[root@localhost UPSMON_PRO_Linux]# ./upsmon-pro-test
[root@localhost UPSMON_PRO_Linux]# UPSMON : Battery Test

dinow@localhost:/home/dinow/UPSMON_PRO_Linux
File Edit View Search Terminal Help

Power Status      : AC Utility Power
Input Voltage     : 111 Volts
Input Frequency   : 59 Hz
Output Voltage    : 120 Volts
Ups Status        : Normal
Ups Load          : 0 Percent
Ups Temperature   : 31 C
Ups Beeper        : ON
Battery Status     : Discharge (Battery Test)
Battery Capacity  : 99 Percent
Battery Voltage   : 2.19 Volts
Battery Backup Time : 199 Minutes (Estimate)
Battery Test Times : 3 Times
Battery Last Test  : 10:16:42 2015/06/03
Battery Test Result : Battery Normal
Battery Age       : 2 Days
Upsmon Pro Linux   : V1.22
Upsmon Pro Status  : Monitoring
Upsmon Pro Update  : 10:16:42 2015/06/03
  
```

Diagram : UPS Batter Test

E.4 Command : **upsmon-pro-beeper-on**

==> Ups alarm for ups warning condition

E.5 Command : **upsmon-pro-beeper-off**

==> Ups silence for ups warning condition

E.6 Command : **upsmon-pro-ups-reboot**

==> Description : Shutdown Linux and reboot ups after XX minutes

- **a. Ups reboot after minutes** : Ups reboot its power after 1 minute
- **b. Commit ups reboot** (Y / n) :

E.7 Command : **upsmon-pro-outlet1-off**

==> It will turn ups outlet1 OFF at once

E.8 Command : **upsmon-pro-outlet1-on**

==> It will turn ups outlet1 ON at once

E.9 Command : **upsmon-pro-outlet2-off**

==> It will turn ups outlet2 OFF at once

E.10 Command : **upsmon-pro-outlet2-on**

==> It will turn ups outlet2 ON at once


==> ups outlets control is specific for certain ups

## FF. UPSMON PRO Multi-Connect

==> The UPSMON PRO can play the role as Master or Slave

### F.1 UPSMON PRO Master

- UPSMON PRO Master : The Linux who physically connects UPS via RS232 or USB
- UPSMON PRO Master : It can share UPS status to the other UPSMON PRO Slaves
- EX : UPSMON PRO Master : 10.192.136.231 (IP Address)

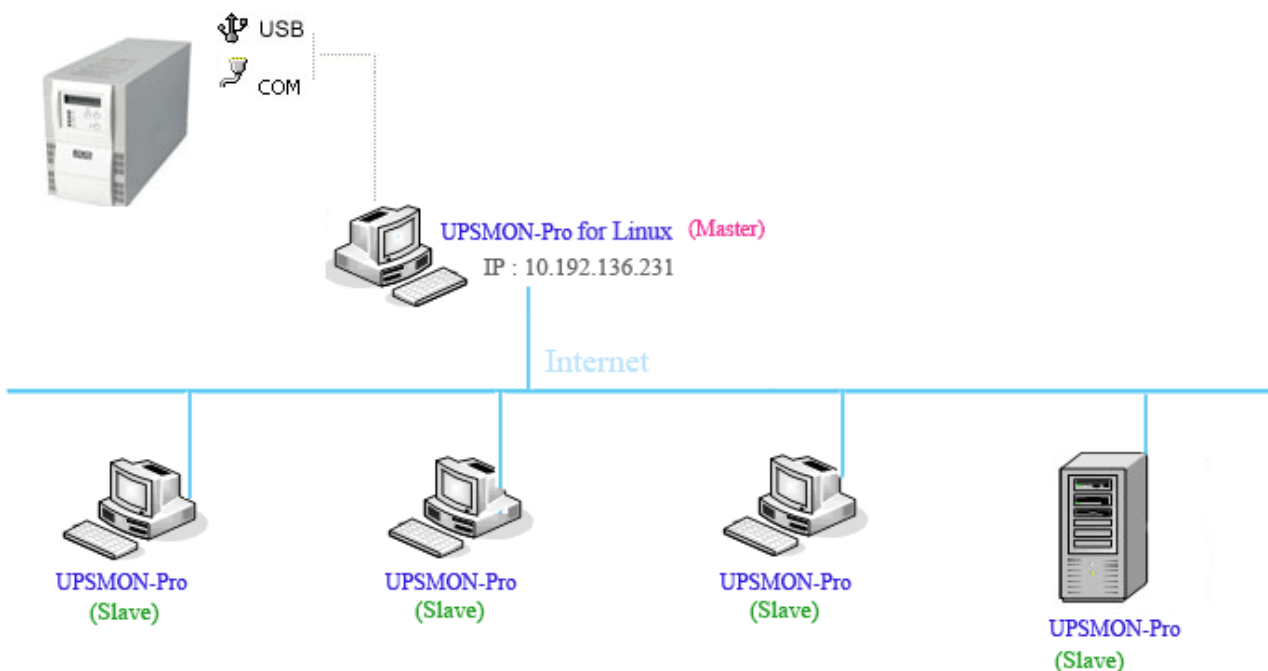

### F.2 UPSMON PRO Linux Slave

- UPSMON PRO Slave : The Linux who connect to UPSMON PRO Master via net
- UPSMON PRO Slave : Execute upsmmon-pro-start with 4 upsmmon-pro parameter

```

Applications  Places  System  [Icons]
dinow@localhost:/home/dinow/UPSMON_PRO_Linux
File Edit View Search Terminal Help

[root@localhost UPSMON_PRO_Linux]# ./upsmmon-pro-start

a. UPS connection: 1.RS232  2.USB  3.SNMP-Card  4.UPSMON-PRO : 4
b. UPSMON-PRO IP address : 10.192.136.231
c. Linux shutdown delay seconds (default : 120) :
d. Linux shutdown if battery capacity % (default : 30 ) :
e. Linux shutdown if battery backup minutes (default : 5 ) :
e. Would you need to reset (default : N ) :

[root@localhost UPSMON_PRO_Linux]# UPSMON : UPSMON Start
[root@localhost UPSMON_PRO_Linux]# UPSMON : Start Monitor
  
```

### F.3 UPSMON PRO Windows Slave

- UPSMON PRO Slave : The Windows who connect to UPSMON PRO Master via net
- UPSMON PRO Slave : Connect : Choose UPSMON PRO

UPSMON PRO for Windows V1.22

Power Source Battery Capacity Load Level **UPSMON PRO**

Monitor System  
Current Status  
Historical Event  
Record Viewer  
Configuration  
Run Time  
Notification  
UPS Control  
Connect  
Schedule  
Help and Support

☐ USB  
☐ SNMP Card 192.168.001.254  
☐ COM Port 1  
☒ UPSMON PRO 010.192.136.231

☐ Web Server UPSMON Function  
Port 8000  
User Name UPSMON  
Password UPSMON  
APP Control Password UPSMON

☒ English ☐ 正體中文


## GG. UPSMON PRO Auto Start

G.1 Command : / path / UPSMON\_PRO\_Linux / [upsmon-pro-service](#)

==> To have a daemon start every time Linux reboot, please add above script into beginning procedures.

Typically this script locate in “/etc/rc.d/” or “/etc/rc.d/rc.local” or “/etc/init.d/rc.local”. However the name and path vary by the distribution

## HH. VMWare Support

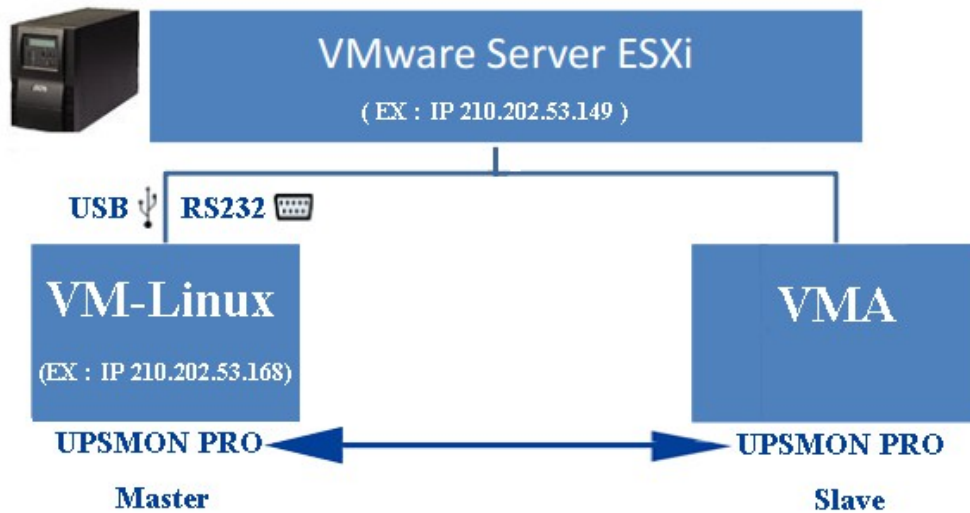


### H.1 Get ups monitoring on vm-linux


1. UPSOM PRO installed on vm-linux (Refer [AA](#))
2. UPSOM PRO get ups monitoring via **usb-port** or **com-port**
3. UPSOM PRO now play the role as **master**

### H.2 VMA Install (**vSphere Management Assistant**)

1. VMWare web site ==> <https://www.vmware.com/support/developer/vima/>
2. Download the **VMA**

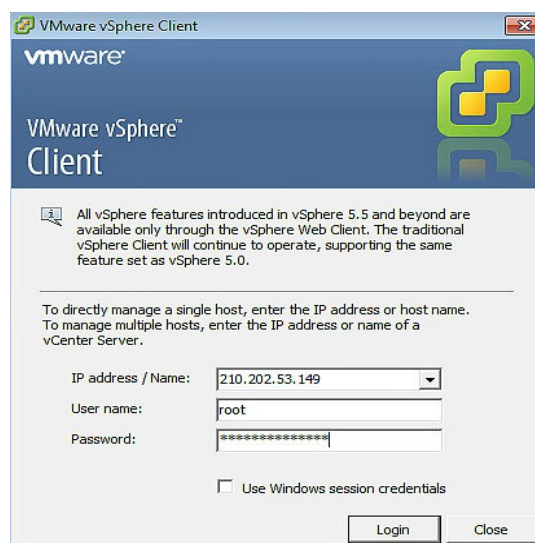

3. Start the **VMware vSphere Client**
4. Select “File” > “Deploy OVF Template”. Click the browse button and select the OVF document.

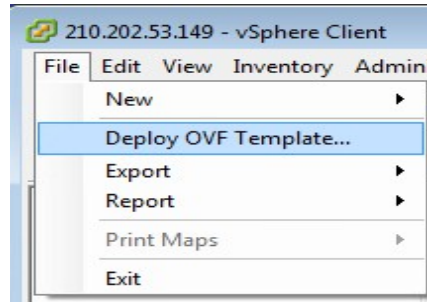

5. Execute VMA and the default user name is **vi-admin**. Set the password before first login

### H.3 UPSMON PRO Install and start monitoring on VMA

1. Command : **cp UPSMON\_PRO\_Linux.tar /home/user**
2. Command : **tar -xvf UPSMON\_PRO\_Linux.tar**
3. Command : **cd UPSMON\_PRO\_Linux**
4. Command : **./upsmon-pro-start**
5. UPSMON-PRO : **4**
6. UPSMON-PRO-Master IP Address
7. Count down seconds

```

UPS VMA TEST
localhost:/home/dinow/UPSMON_PRO_Linux # ./upsmon-pro-start
a. UPS connection: 1.RS232 2.USB 3.SNMP-Card 4.UPSMON-PRO : 4
b. UPSMON-PRO IP address : 210.202.53.168
c. Linux shutdown delay seconds (default : 120) : 60
d. Linux shutdown if battery capacity % (default : 30 ) :
e. Linux shutdown if battery backup minutes (default : 5 ) :
f. Would you need to reset (default : N ) :

localhost:/home/dinow/UPSMON_PRO_Linux # UPSMON : UPSMON Start
localhost:/home/dinow/UPSMON_PRO_Linux # UPSMON : Start Monitor
localhost:/home/dinow/UPSMON_PRO_Linux #
  
```

8. Command : `./upsmon-pro-status`

```

UPS VMA TEST
Power Status      : AC Utility Power
Input Voltage     : 110 Volts
Input Frequency   : 59 Hz
Output Voltage    : 120 Volts
Ups Status        : Normal
Ups Load          : 0 Percent
Ups Temperature   : 27 C
Ups Beeper        : OFF
Battery Status     : Charge
Battery Capacity  : 69 Percent
Battery Backup Time : 158 Minutes (Estimate)
Battery Power Times : 2 Times
Battery Power Start : 11:09:26 2017/06/26
Battery Age        : 1 Day
Upsmon Pro Linux   : V1.26
Upsmon Pro Status  : Monitoring
Upsmon Pro Update  : 11:42:10 2017/06/26
  
```


#### H.4 UPSMON PRO VMWare shutdown configuration

1. Command : `upsmon-pro-vmware`
2. Filled in your Vmware Esxi **IP** / **root** (administrator) / **password**


```

localhost:/home/dinow/UPSMON_PRO_Linux # ./upsmon-pro-vmware
a. VMWare Server Shutdown (Y/n):
b. VMWare Server IP : 210.202.53.149
d. VMWare Root Account (default : root):
e. VMWare Root Password :
i. Would you need to reset (N/y):
  
```

#### H.5 Configure startup/shutdown **automatically** with VMware ESXi

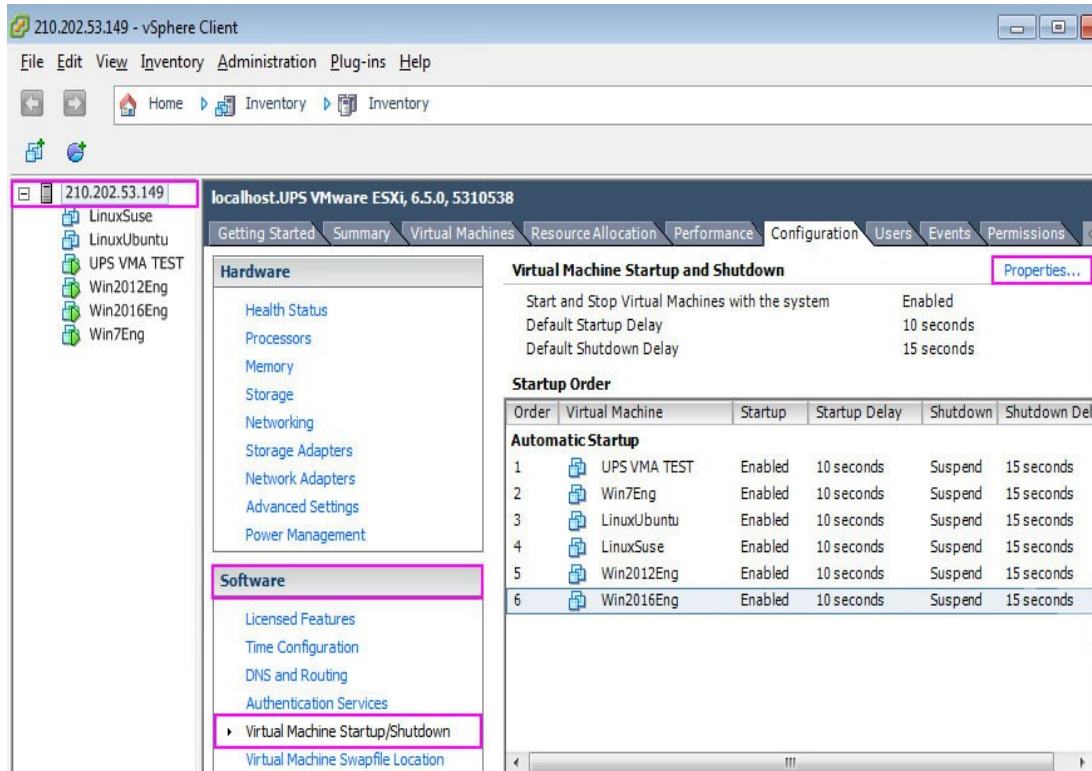


1. Vmware host >> Software >> Virtual Machine Startup / Shutdown >> Properties
2. This windows is allowed you to setup :  
==> shutdown type / shutdown delay / shutdown order / startup order

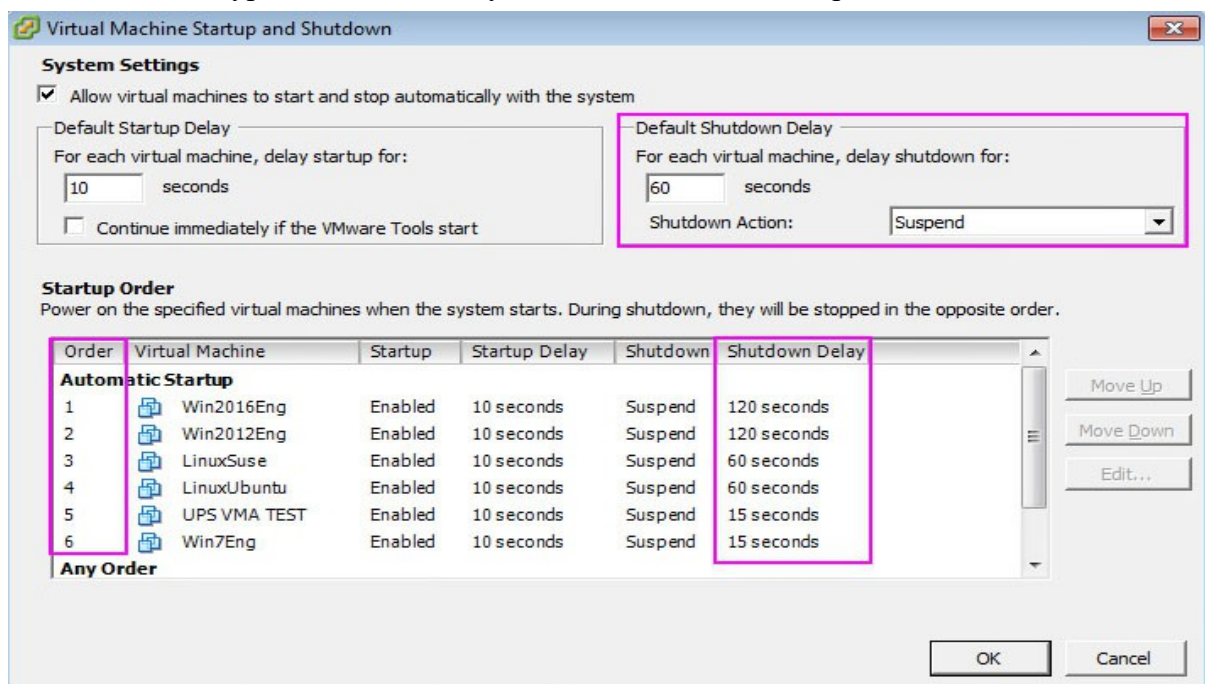

Ex : In above example : Win7Eng shutdown **first** / Win2016Eng shutdown **last**

## H.6 Power failure and the vmware shutdown as sequence

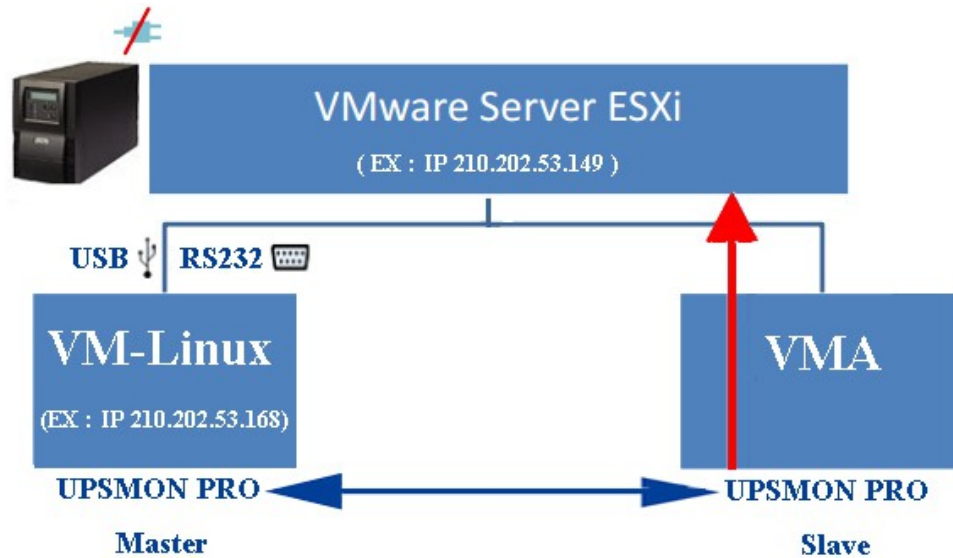

```

localhost:/home/dinow/UPSMON_PRO_Linux # UPSMON : Power Failure
UPSMON : Linux count down 60 seconds

UPSMON : Power Failure and Linux is going to shutdown

UPSMON : Linux count down 60 seconds

UPSMON : Linux count down 30 seconds

UPSMON : Linux count down 10 seconds

UPSMON : Execute VMWare Shutdown

```

210.202.53.149 - vSphere Client							
File Edit View Inventory Administration Plug-ins Help							
Name	Target	Status	Details	Initiated by	Requested Start Time	Start Time	
Suspend virtual machi...	Win2016Eng	22%		root	6/16/2017 9:38:30 PM	6/16/2017 9:38:30 PM	
Suspend virtual machi...	Win2012Eng	62%		root	6/16/2017 9:38:15 PM	6/16/2017 9:38:15 PM	
Suspend virtual machi...	LinuxSuse	45%		root	6/16/2017 9:38:00 PM	6/16/2017 9:38:00 PM	
Suspend virtual machi...	LinuxUbuntu	✓ Completed		root	6/16/2017 9:37:46 PM	6/16/2017 9:37:46 PM	
Suspend virtual machi...	UPS VMA TEST	✓ Completed		root	6/16/2017 9:37:31 PM	6/16/2017 9:37:31 PM	
Suspend virtual machi...	Win7Eng	✓ Completed		root	6/16/2017 9:37:16 PM	6/16/2017 9:37:16 PM	
Auto powerOff	210.202.53.149	✓ Completed		root	6/16/2017 9:37:16 PM	6/16/2017 9:37:16 PM	
Initiate host shutdown	210.202.53.149	✓ Completed		root	6/16/2017 9:37:16 PM	6/16/2017 9:37:16 PM	

## H.7 Configuration to auto start up VMwareESXi

Command : / path / UPSMON\_PRO\_Linux / **upsmon-pro-service**

==> To have a daemon start every time vma reboot, please add above script into beginning procedures. Typically this script locate in “/etc/rc.d/rc3.d” and “/etc/rc.d/rc5.d”. However the name and path vary by the distribution

```
localhost:/etc/rc.d/rc3.d # cat S14upsmon
/home/dinow/UPSMON PRO Linux/upsmon-pro-service
localhost:/etc/rc.d/rc3.d # cd ../rc5.d
localhost:/etc/rc.d/rc5.d # cat S14upsmon
/home/dinow/UPSMON PRO Linux/upsmon-pro-service
localhost:/etc/rc.d/rc5.d # _
```

## II. Q and A

### H.1 Supported Operating Systems

- CentOS
- Debian
- Fedora
- RedHat
- Suse
- OpenSuse
- Ubuntu
- Mint

### H.2 Linux usb connect Fail :

Command : `sudo apt-get install lib32bz2-1.0` (Debian)


Command : `sudo apt-get install lib32z1` (Ubuntu / Mint)

Command : `yum install glibc.i686` (Fedora / CentOS)

### H.3 Stop the service with command

Command : `ps -aux | grep "noverify"`

Command : PID

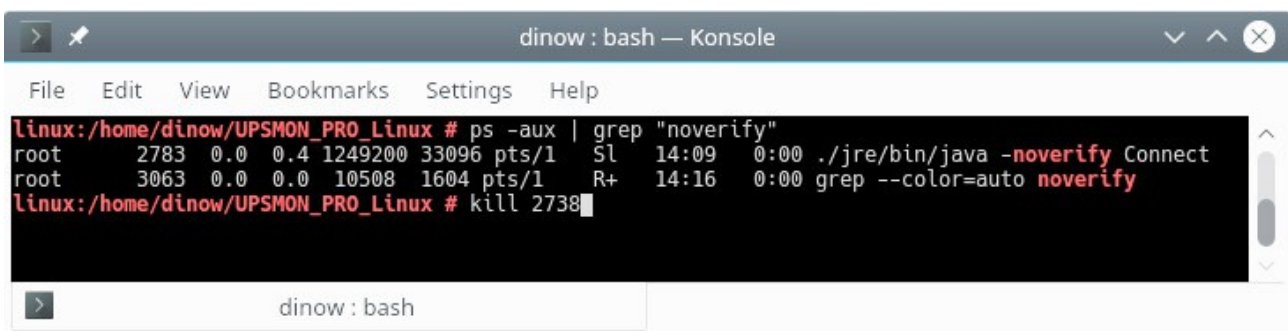

```
dinow : bash — Konsole
File Edit View Bookmarks Settings Help
linux:/home/dinow/UPSMON_PRO_Linux # ps -aux | grep "noverify"
root      2783  0.0  0.4 1249200 33096 pts/1    Sl   14:09   0:00 ./jre/bin/java -noverify Connect
root      3063  0.0  0.0 10508 1604 pts/1      R+   14:16   0:00 grep --color=auto noverify
linux:/home/dinow/UPSMON_PRO_Linux # kill 2738
dinow : bash
```

#### H.4 Former ups and its usb connection :

Command : cd Class/EXT

Command : vi UPS\_USB\_2400.txt ./UPS\_USB\_1200.txt

Command : lsusb (Usb devices)

Command : usb-devices

#### H.5 AstraLinux can execute java file

==> AstraLinux App : **Synaptic Package Manager** : Update file (Search keyword : **lib32**)

#### H.6 Ubuntu : library initialization failed unable to allocate file descriptor table – out of memory

Command : ulimit -n 10000